


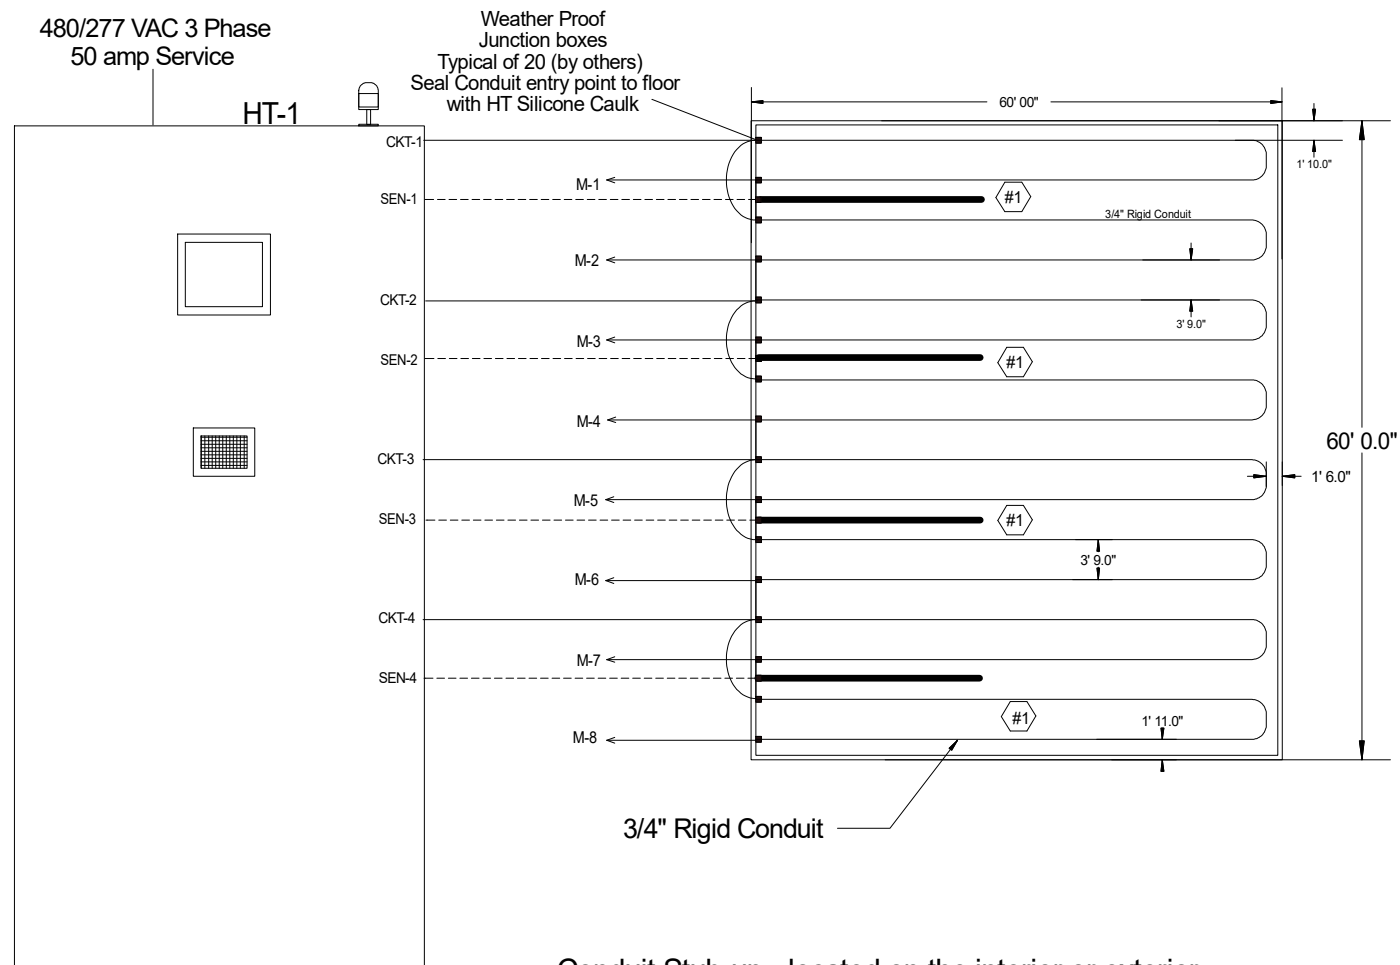

Conduit Stub-up - located on the interior or exterior

Circuit #1-4 - (2) runs each Heat trace 277 Volts, 8.2amps - inrush up to 25 amps. Home runs to HT-1

Sensor #SEN-1-54 Type J Thermocouple 50' leads, use 20 Gauge PVC / PVC Type J extension grade wire only To HT-1

Monitor # 1-8 End Run Monitor Circuits Typical , Less than 1 amp, Home run to panel HT-1

General Notes										
#1										
3/4" CONDUIT FOR TEMPERATURE SENSOR 30' CAP AT END										
<table border="1"> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> </table>										
Thermal Equipment Sales Co (901) 452-4516 Memphis TN 38113 Thermalinc.com										
-10 Freezer w/ 6" Insulation 60' x 60' 480/277 Volt 3 Phase										
<table border="1"> <tr> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> </tr> </table>							REV2 -10 C			